



Fig. 2A

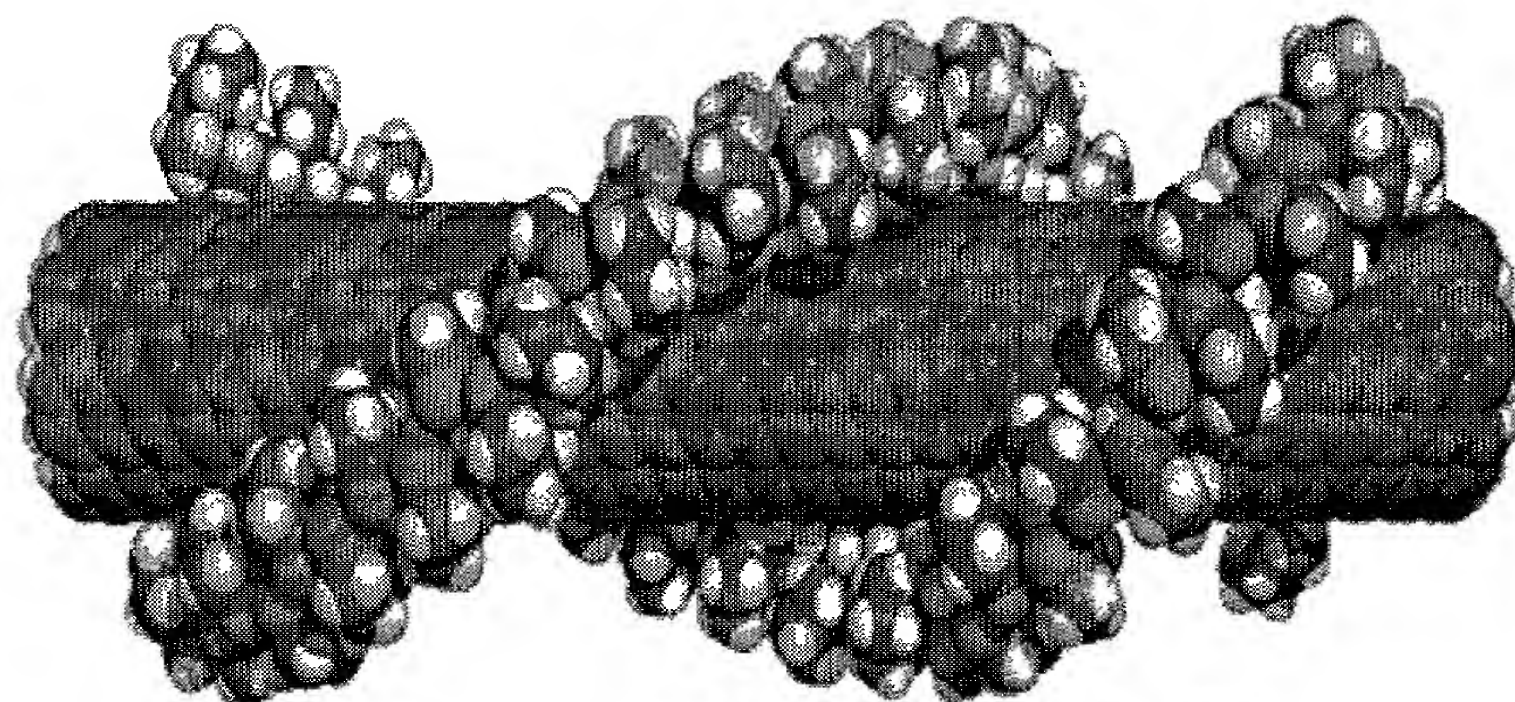


Fig. 2B

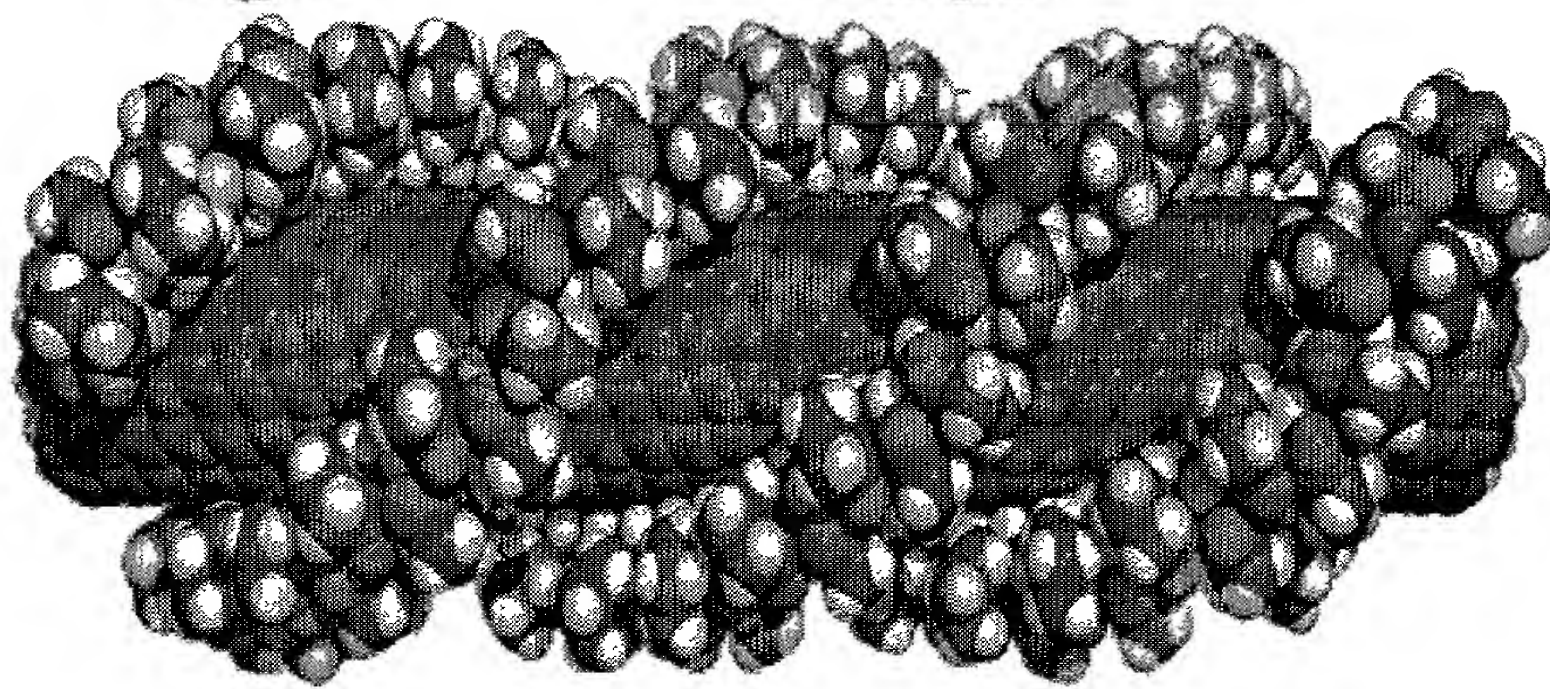


Fig. 2C

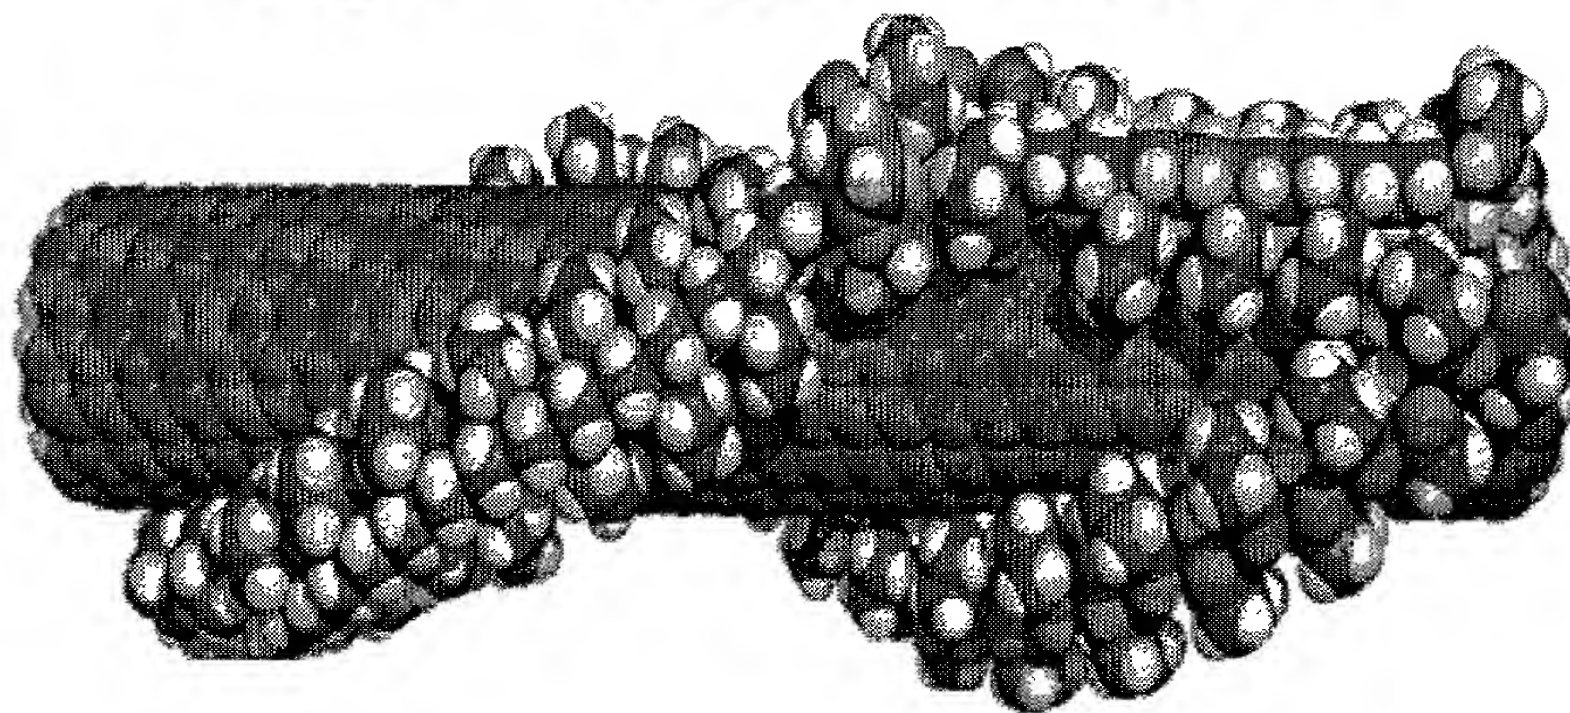




Fig. 3A

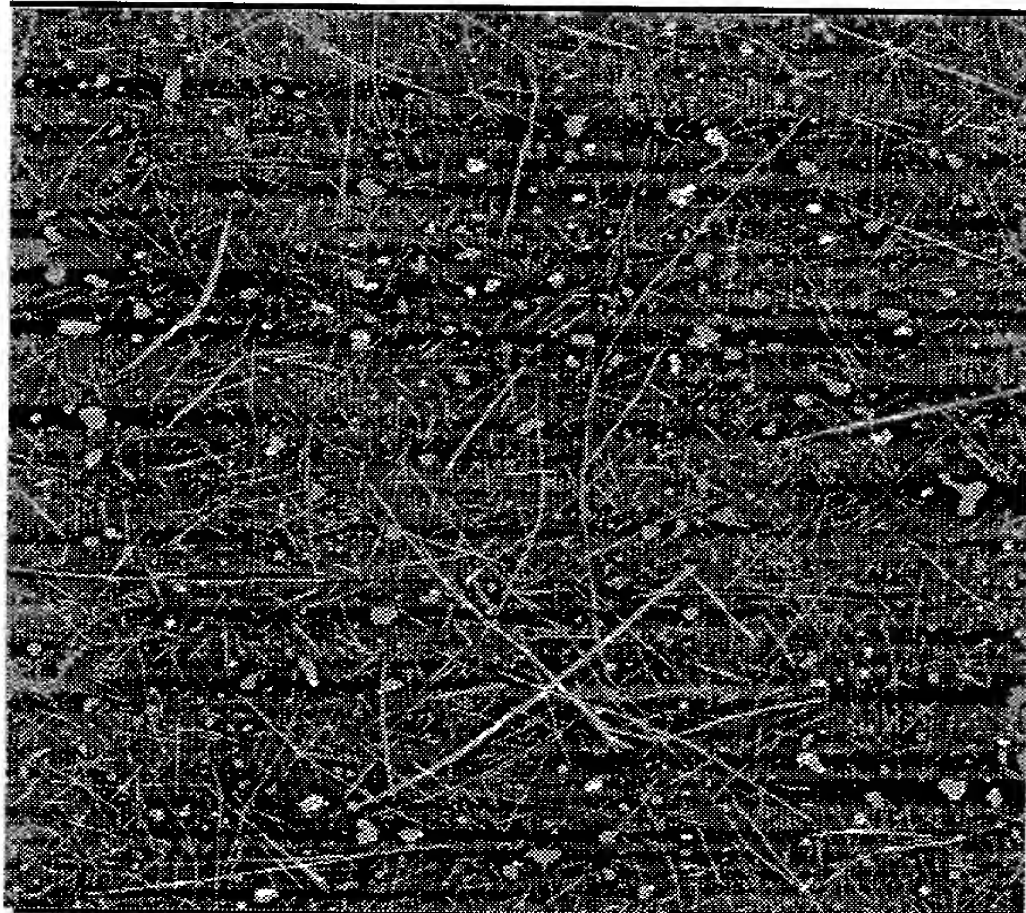


Fig. 3B

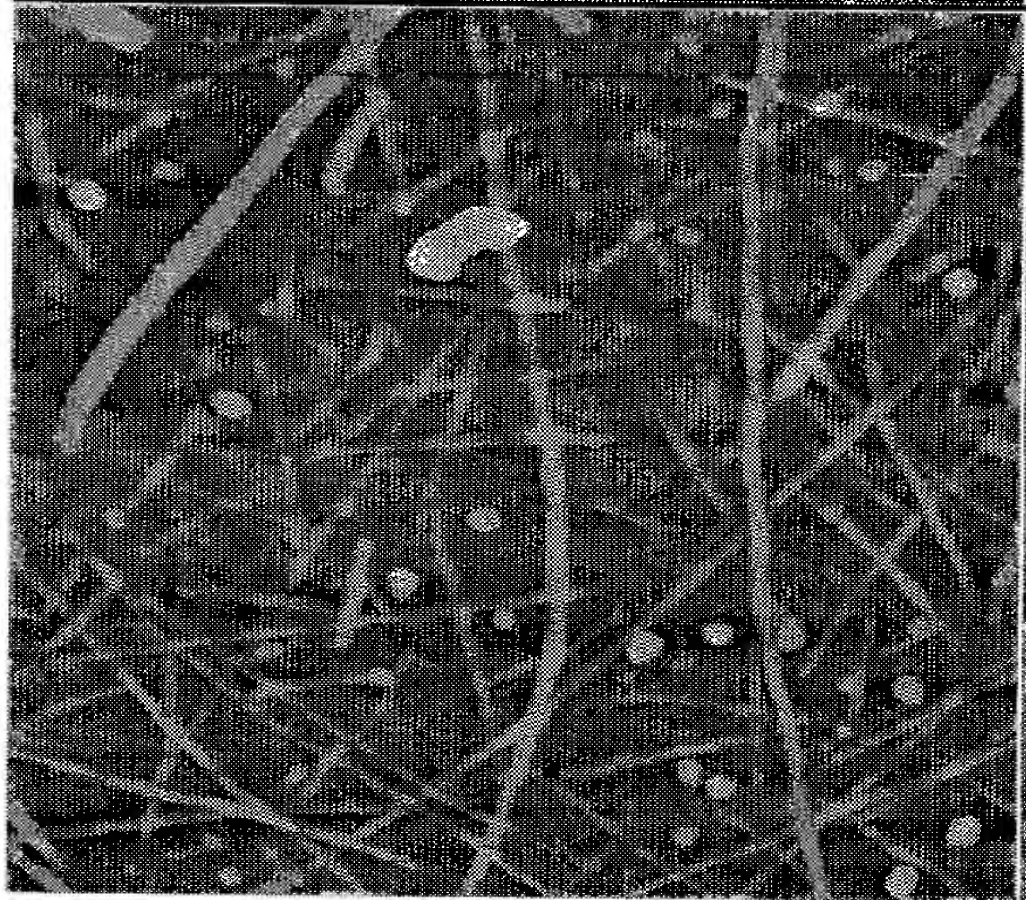
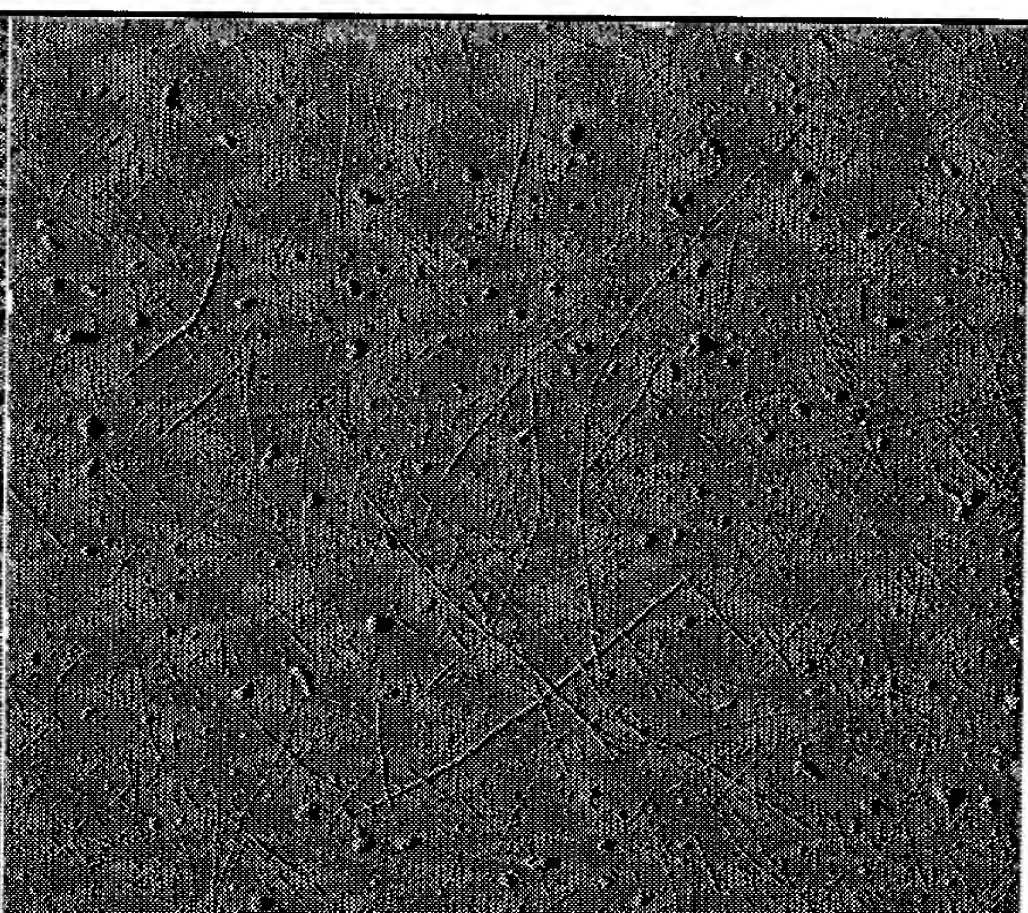


Fig. 3C

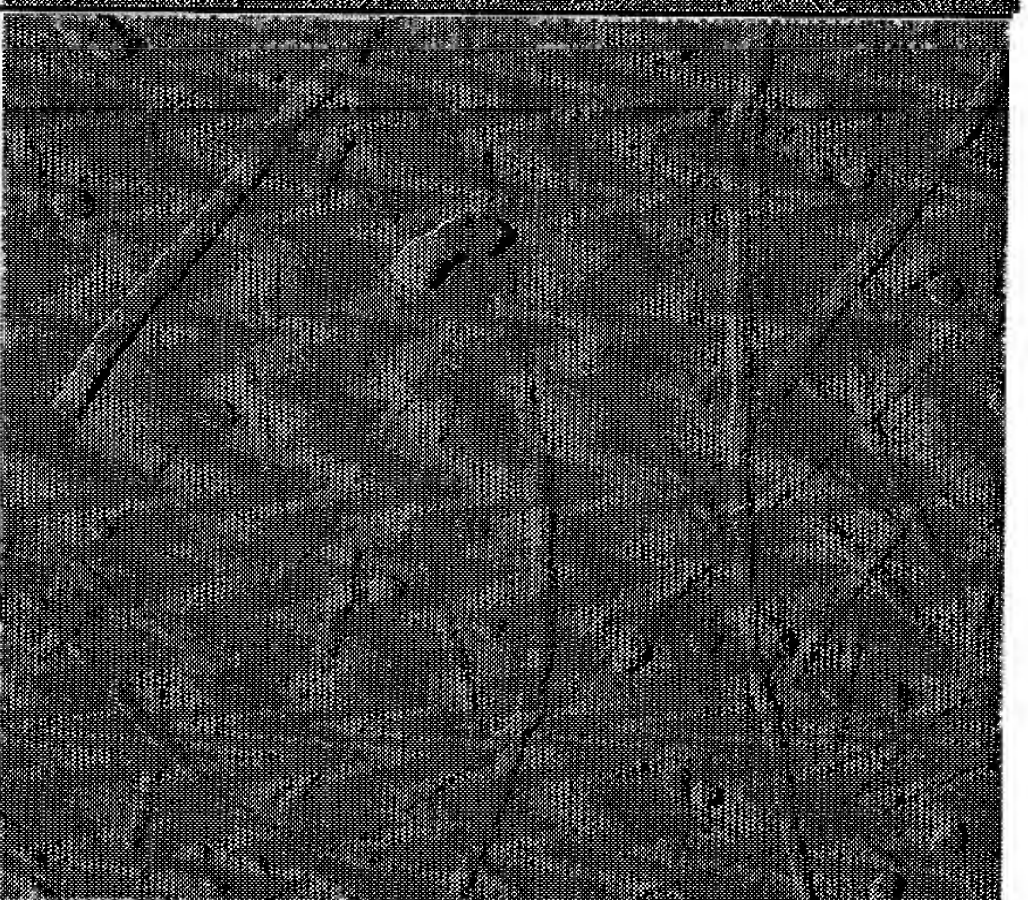


Fig. 3D



Fig. 4A

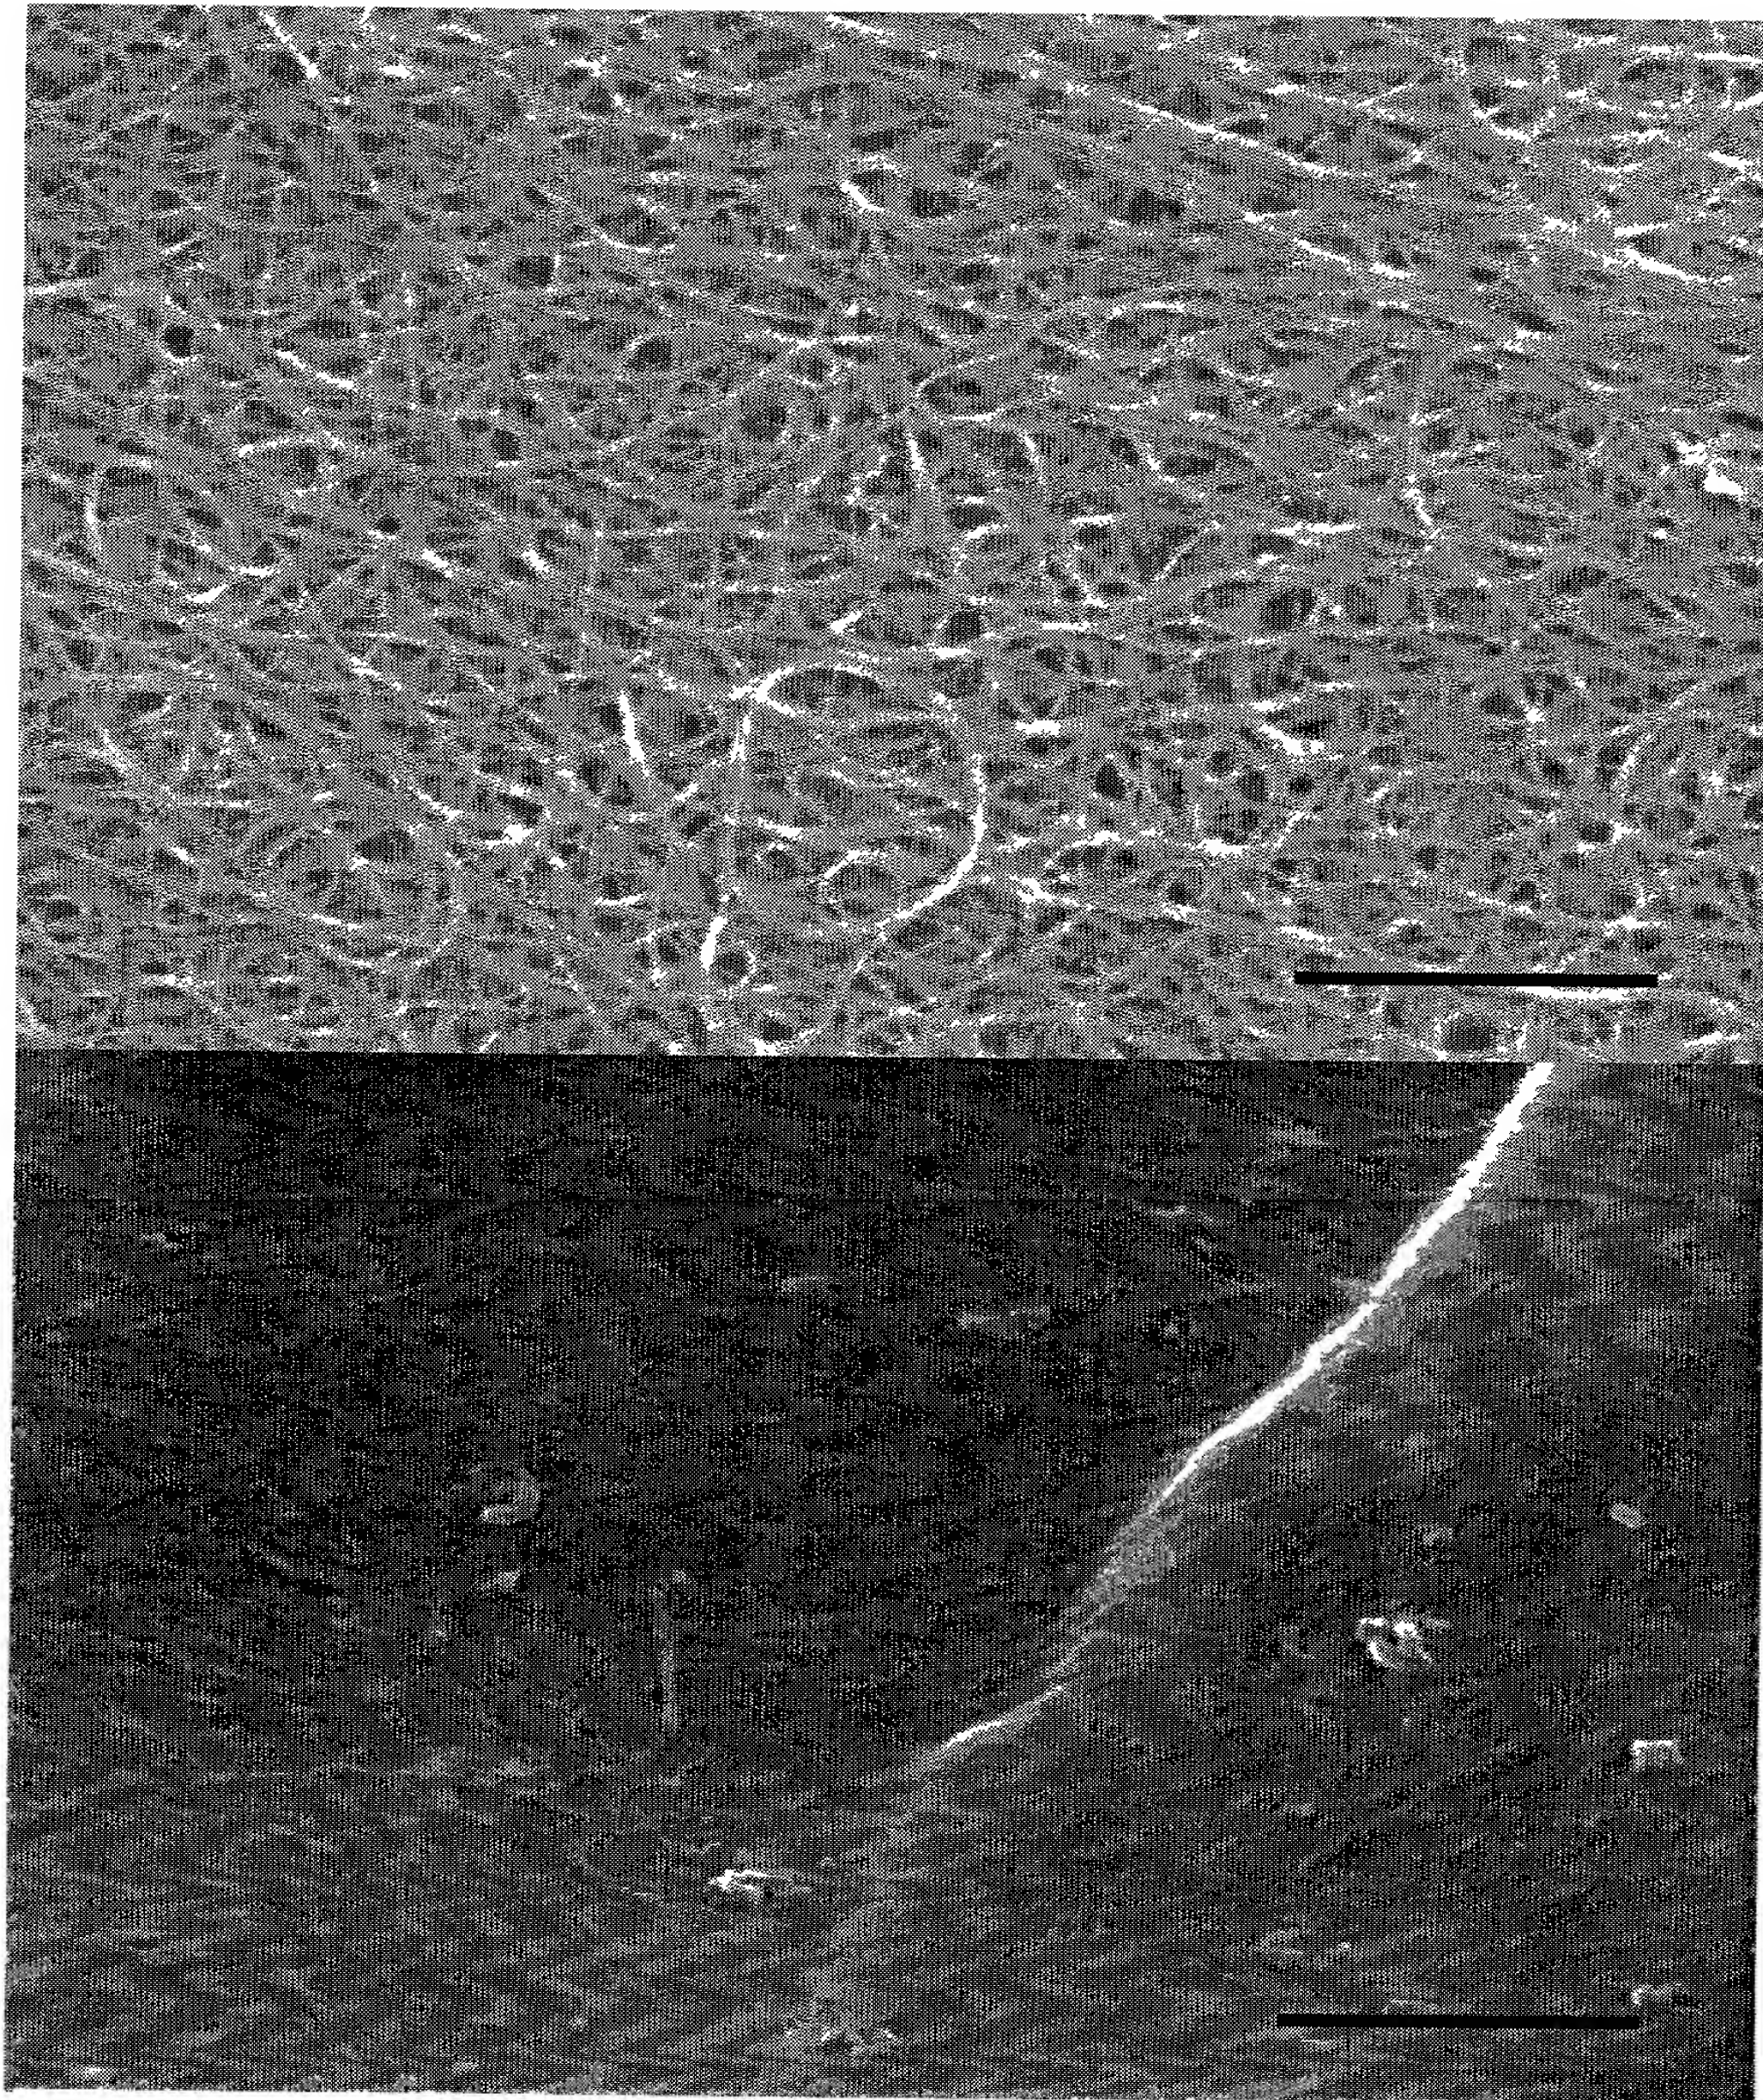


Fig. 4B




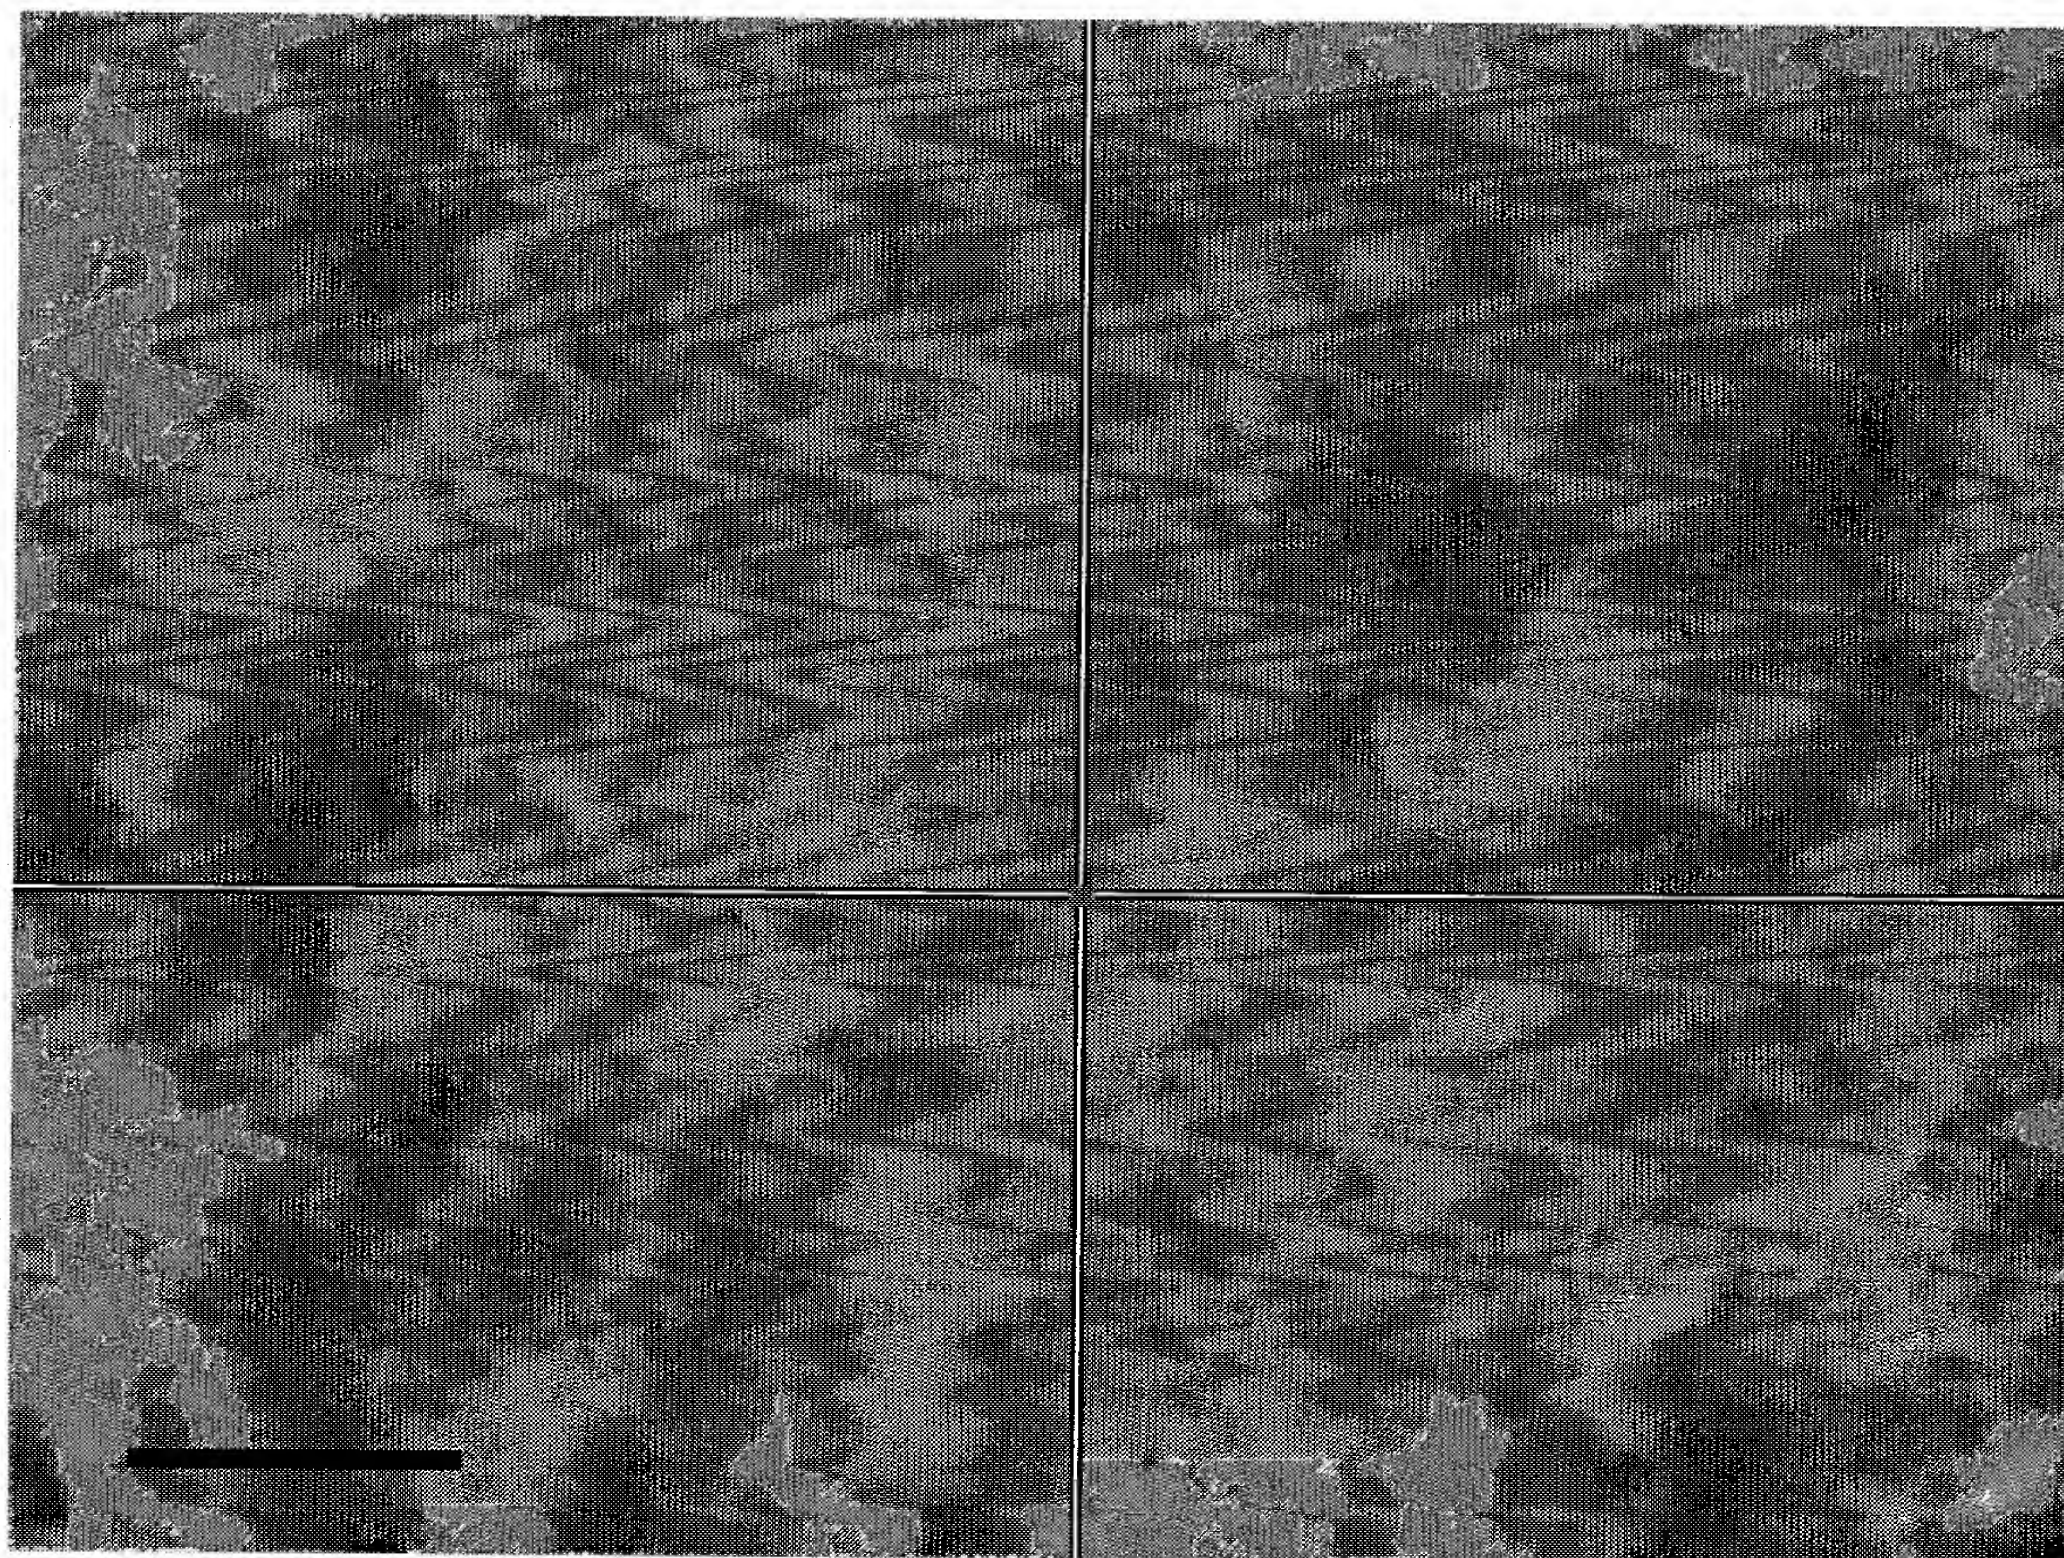
[illegible]

Fig. 5



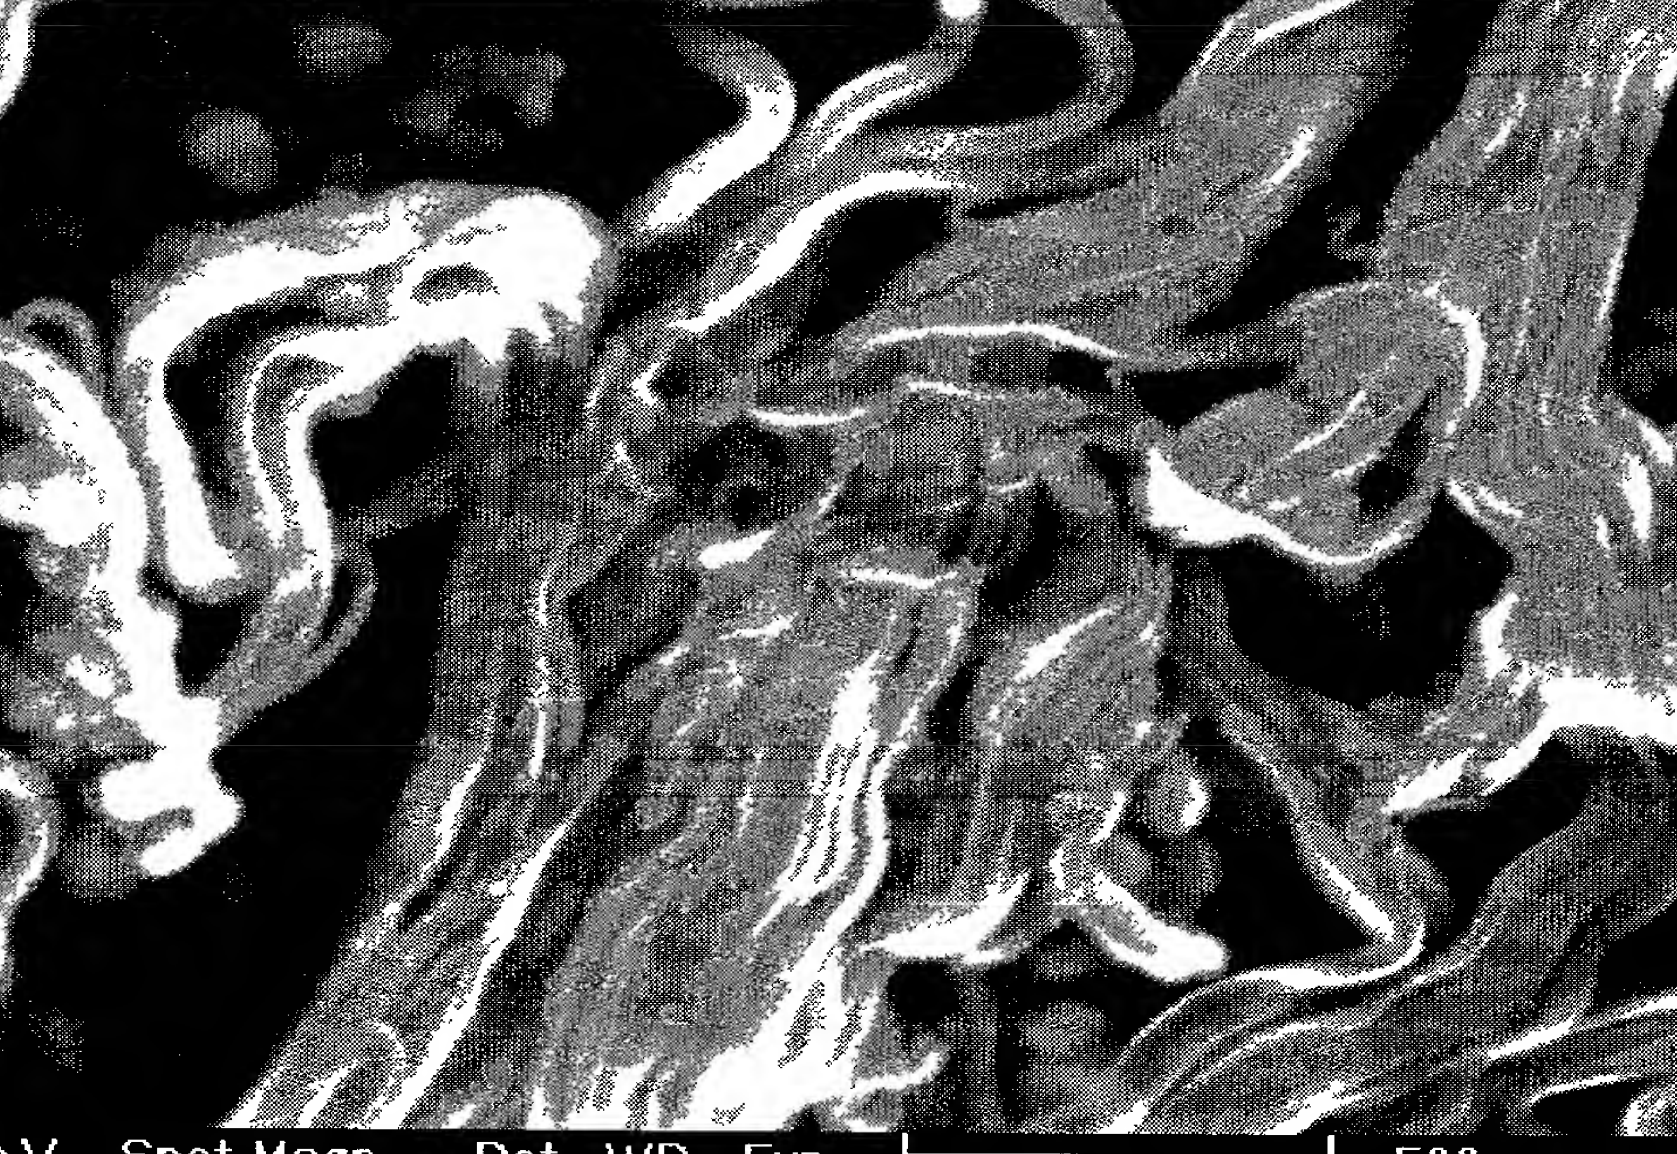

Acc.V Spot Magn Det WD Exp | 500 nm  
30.0 kV 3.0 50000x SE 25.7 1 Hivac

Fig. 6

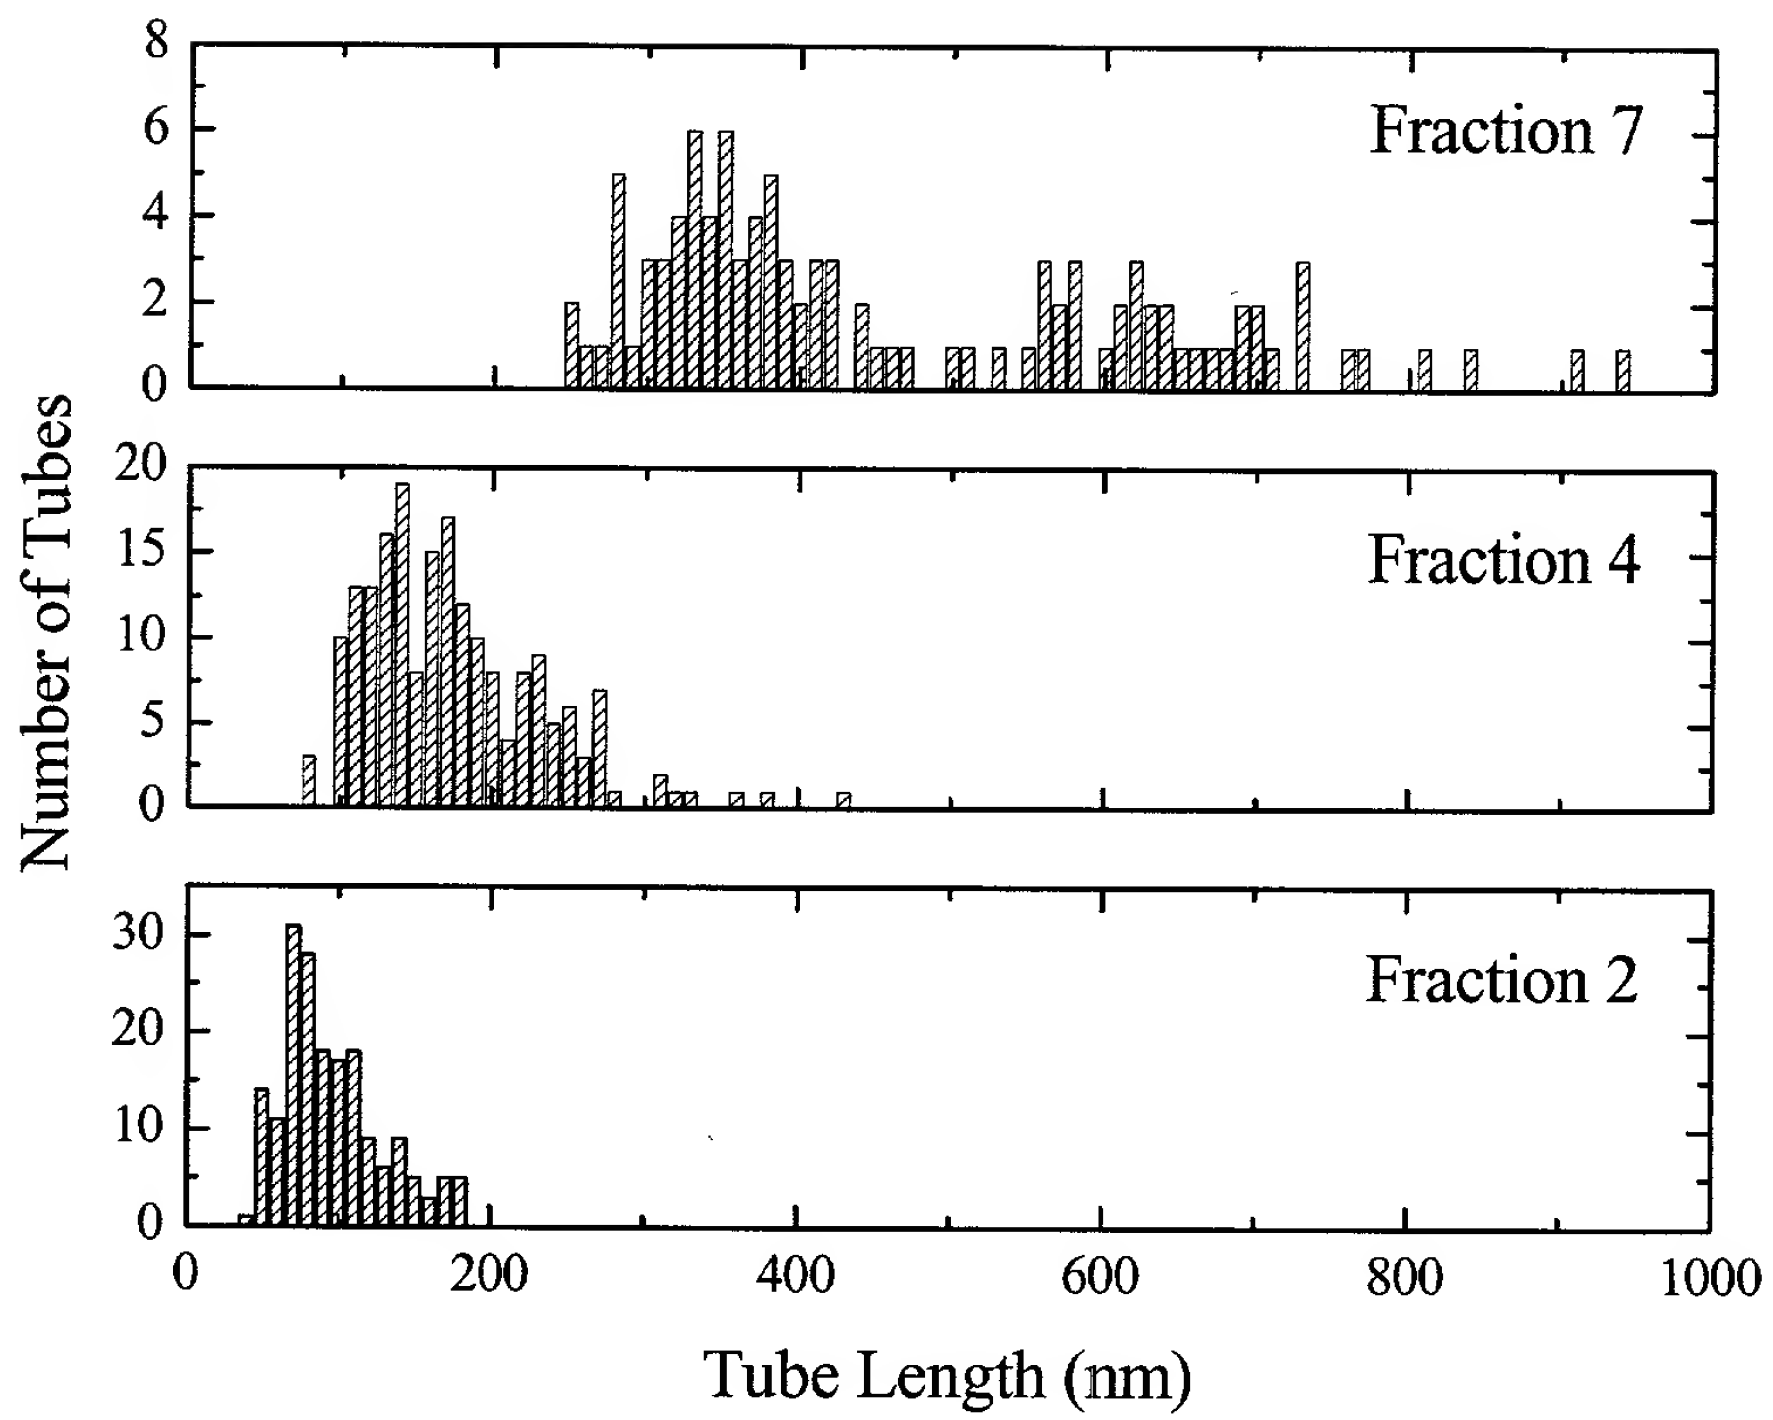


Fig 7A

Fig 7B

Fig 7C